



Windload Charts | T500 (OPG6000) Series

A = 16 P.S.F. (766 Pa) Description: 2 1/4" X 6" With 1/4" - 1 11/16" Glass
B = 20 P.S.F. (958 Pa) Function: Curtain Wall
C = 25 P.S.F. (1197 Pa) Detail: Design Criteria
D = 30 P.S.F. (1436 Pa) Scale: N.T.S.
E = 40 P.S.F. (1915 Pa) SHEET 1 OF 5

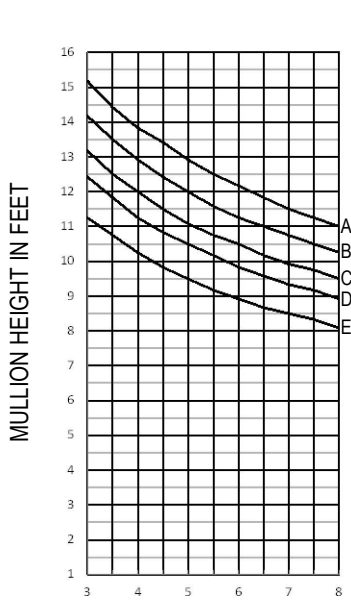

MULLION SPACING IN FEET


OPG6010

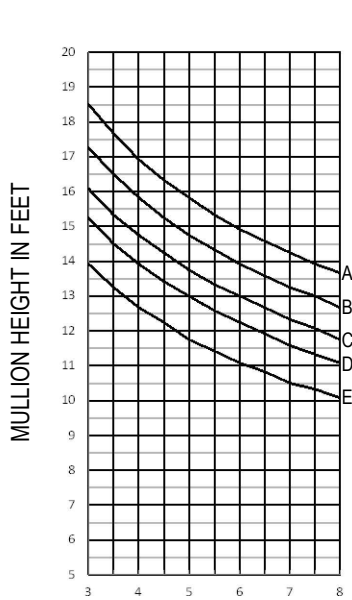

MULLION SPACING IN FEET


OPG6010 WITH
STEEL REINFORCEMENT
1 7/8" X 3 9/16" X 10 GA.

- Mullions are assumed to be single span, simple beam elements, uniformly loaded and adequately braced to prevent lateral-torsional buckling. All other complex design conditions shall be reviewed by Arcadia or a design professional.
- Aluminum extrusions shall be 6063-T6 alloy. Allowable stresses to be derived per Aluminum Design Manual. Deflection limitation of mullions shall be in accordance with AAMA TIR-A11 of L/175 for spans up to 13'-6" and L/240 + 1/4" for all others where L is equal to the span of mullion.
- A design professional shall be consulted to confirm that no lite of glass deflects more than H/175 or 3/4", whichever is less, where H indicates the height of glass.
- For mullions containing steel reinforcement, the reinforcement is assumed to be installed for the full length of the mullion. A design professional shall be consulted for instances where steel reinforcement is installed for a partial length of the mullion span.
- Windload pressure determinations shall be per ASCE 7 and according to local governing codes. A professional engineer shall be consulted for the most current laws and local building codes.
- Selection of perimeter fasteners and attachment of glazing system to building structure are project specific and therefore shall be reviewed and determined by a design professional.
- Arcadia assumes no responsibility for selecting the appropriate systems for specific projects.

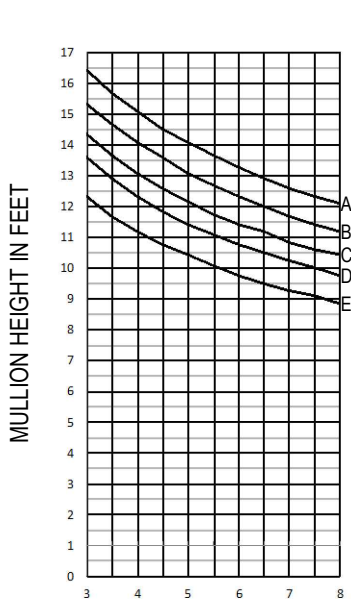

MULLION SPACING IN FEET


OPG6011

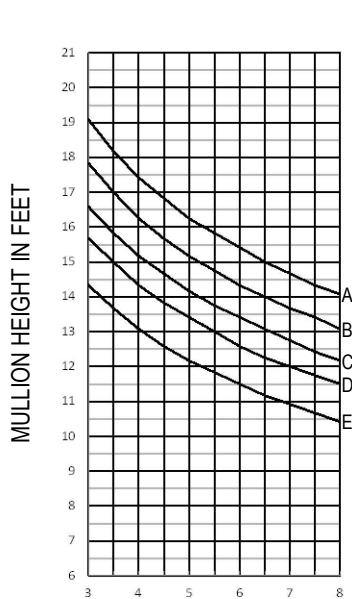

MULLION SPACING IN FEET


OPG6011 WITH
STEEL REINFORCEMENT
1 7/8" X 3 3/8" X 10 GA.

Consult Your Local Arcadia Representative For Special Applications Not Covered By These Curves.




Windload Charts | T500 (OPG6000) Series


A = 16 P.S.F. (766 Pa) Description: 2 1/4" X 6" With 1/4" - 1 11/16" Glass
B = 20 P.S.F. (958 Pa) Function: Curtain Wall
C = 25 P.S.F. (1197 Pa) Detail: Design Criteria
D = 30 P.S.F. (1436 Pa) Scale: N.T.S.
E = 40 P.S.F. (1915 Pa) SHEET 2 OF 5

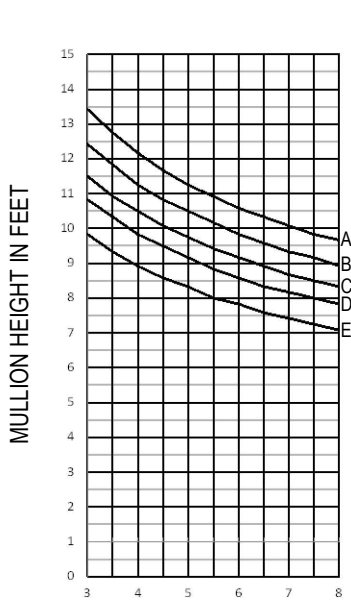


MULLION SPACING IN FEET



OPG6020

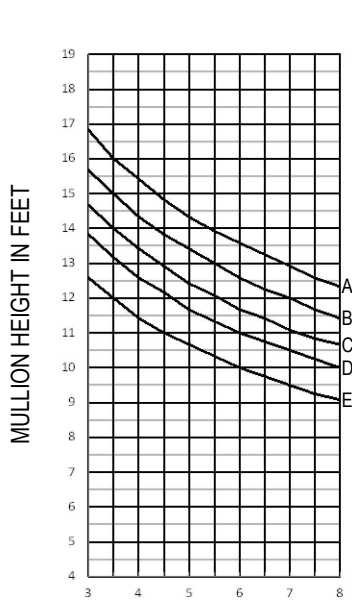


MULLION SPACING IN FEET




OPG6020 WITH
STEEL REINFORCEMENT
1 7/8" X 3 1/4" X 10 GA.


- Mullions are assumed to be single span, simple beam elements, uniformly loaded and adequately braced to prevent lateral-torsional buckling. All other complex design conditions shall be reviewed by Arcadia or a design professional.
- Aluminum extrusions shall be 6063-T6 alloy. Allowable stresses to be derived per Aluminum Design Manual. Deflection limitation of mullions shall be in accordance with AAMA TIR-A11 of $L/175$ for spans up to 13'-6" and $L/240 + 1/4"$ for all others where L is equal to the span of mullion.
- A design professional shall be consulted to confirm that no lite of glass deflects more than $H/175$ or $3/4"$, whichever is less, where H indicates the height of glass.
- For mullions containing steel reinforcement, the reinforcement is assumed to be installed for the full length of the mullion. A design professional shall be consulted for instances where steel reinforcement is installed for a partial length of the mullion span.
- Windload pressure determinations shall be per ASCE 7 and according to local governing codes. A professional engineer shall be consulted for the most current laws and local building codes.
- Selection of perimeter fasteners and attachment of glazing system to building structure are project specific and therefore shall be reviewed and determined by a design professional.
- Arcadia assumes no responsibility for selecting the appropriate systems for specific projects.

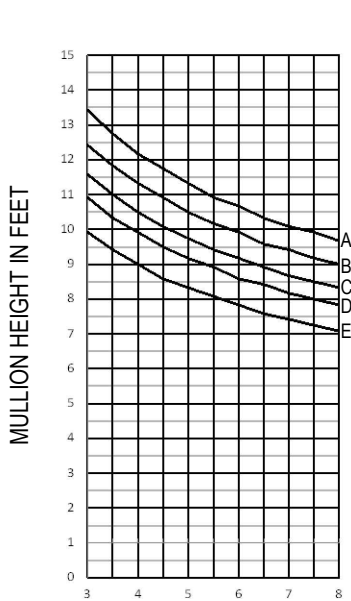


MULLION SPACING IN FEET



OPG6029

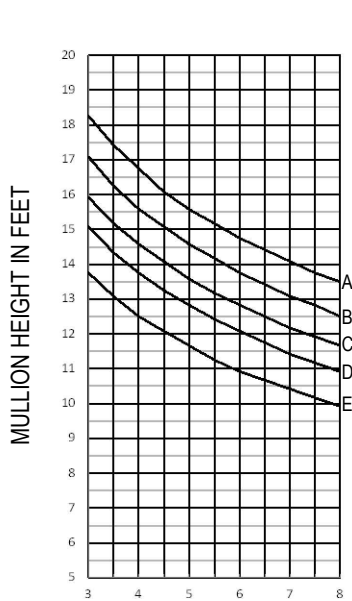


MULLION SPACING IN FEET



OPG6029 WITH
STEEL REINFORCEMENT
1 7/8" X 3 1/4" X 1/4".


Consult Your Local Arcadia Representative For Special Applications Not Covered By These Curves.



Windload Charts | T500 (OPG6000) Series


A = 16 P.S.F. (766 Pa) Description: 2 1/4" X 6" With 1/4" - 1 11/16" Glass
 B = 20 P.S.F. (958 Pa) Function: Curtain Wall
 C = 25 P.S.F. (1197 Pa) Detail: Design Criteria
 D = 30 P.S.F. (1436 Pa) Scale: N.T.S.
 E = 40 P.S.F. (1915 Pa)

SHEET 3 OF 5

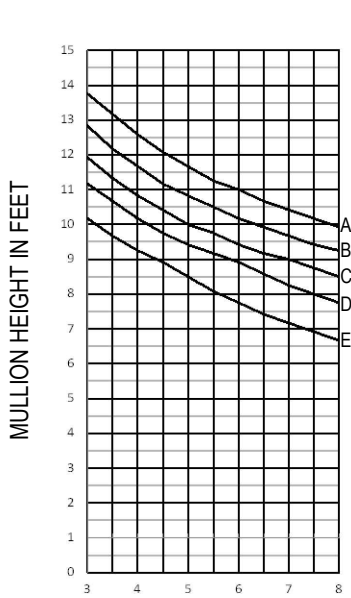


$$I = 4.153 \text{ IN}^4$$


$$S = 1.491 \text{ IN}^3$$



OPG6051

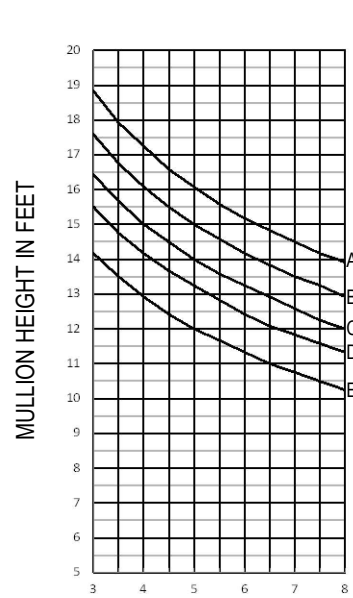


$$I = 11.385 \text{ IN}^4$$




OPG6051 WITH
STEEL REINFORCEMENT
1 7/8" X 3 11/16" X 3/16"

- Mullions are assumed to be single span, simple beam elements, uniformly loaded and adequately braced to prevent lateral-torsional buckling. All other complex design conditions shall be reviewed by Arcadia or a design professional.
- Aluminum extrusions shall be 6063-T6 alloy. Allowable stresses to be derived per Aluminum Design Manual. Deflection limitation of mullions shall be in accordance with AAMA TIR-A11 of L/175 for spans up to 13'-6" and L/240 + 1/4" for all others where L is equal to the span of mullion.
- A design professional shall be consulted to confirm that no lite of glass deflects more than H/175 or 3/4", whichever is less, where H indicates the height of glass.
- For mullions containing steel reinforcement, the reinforcement is assumed to be installed for the full length of the mullion. A design professional shall be consulted for instances where steel reinforcement is installed for a partial length of the mullion span.
- Windload pressure determinations shall be per ASCE 7 and according to local governing codes. A professional engineer shall be consulted for the most current laws and local building codes.
- Selection of perimeter fasteners and attachment of glazing system to building structure are project specific and therefore shall be reviewed and determined by a design professional.
- Arcadia assumes no responsibility for selecting the appropriate systems for specific projects.

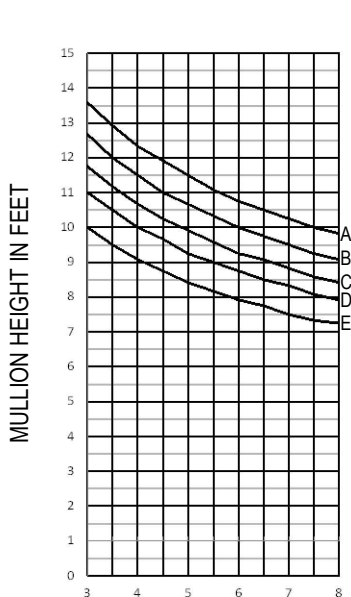


$$I = 3.962 \text{ IN}^4$$


$$S = 1.950 \text{ IN}^3$$



OPG602075

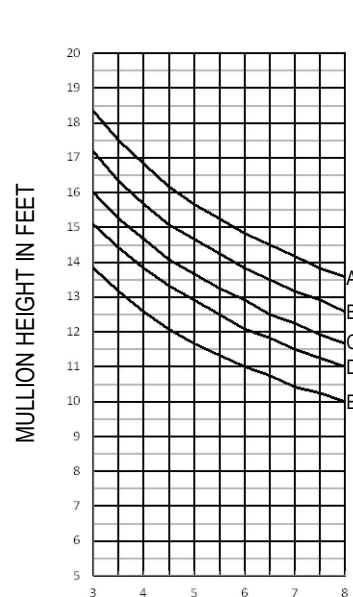


$$I = 10.506 \text{ IN}^4$$



OPG602075 WITH
STEEL REINFORCEMENT
1 7/8" X 3 1/4" X 1/4"


Consult Your Local Arcadia Representative For Special Applications Not Covered By These Curves.



Windload Charts | T500 (OPG6000) Series


A = 16 P.S.F. (766 Pa) Description: 2 1/4" X 6" With 1/4" - 1 11/16" Glass
 B = 20 P.S.F. (958 Pa) Function: Curtain Wall
 C = 25 P.S.F. (1197 Pa) Detail: Design Criteria
 D = 30 P.S.F. (1436 Pa) Scale: N.T.S.
 E = 40 P.S.F. (1915 Pa)

SHEET 4 OF 5

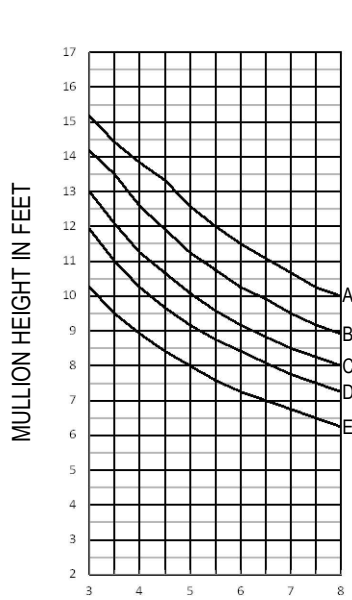


$$I = 5.629 \text{ IN}^4$$

$$S_1 = 1.929 \text{ IN}^3 \quad S_2 = 0.254 \text{ IN}^3$$




MULLION SPACING IN FEET

OPG6049 / OPG6001

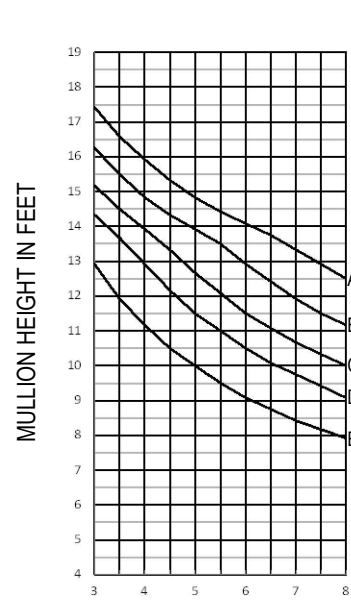


$$I = 8.843 \text{ IN}^4$$



MULLION SPACING IN FEET


OPG6049 / OPG6001 WITH
STEEL REINFORCEMENT
3/4" X 3 9/16" X 3/16"

- Mullions are assumed to be single span, simple beam elements, uniformly loaded and adequately braced to prevent lateral-torsional buckling. All other complex design conditions shall be reviewed by Arcadia or a design professional.
- Aluminum extrusions shall be 6063-T6 alloy. Allowable stresses to be derived per Aluminum Design Manual. Deflection limitation of mullions shall be in accordance with AAMA TIR-A11 of L/175 for spans up to 13'-6" and L/240 + 1/4" for all others where L is equal to the span of mullion.
- A design professional shall be consulted to confirm that no lite of glass deflects more than H/175 or 3/4", whichever is less, where H indicates the height of glass.
- For mullions containing steel reinforcement, the reinforcement is assumed to be installed for the full length of the mullion. A design professional shall be consulted for instances where steel reinforcement is installed for a partial length of the mullion span.
- Windload pressure determinations shall be per ASCE 7 and according to local governing codes. A professional engineer shall be consulted for the most current laws and local building codes.
- Selection of perimeter fasteners and attachment of glazing system to building structure are project specific and therefore shall be reviewed and determined by a design professional.
- Arcadia assumes no responsibility for selecting the appropriate systems for specific projects.

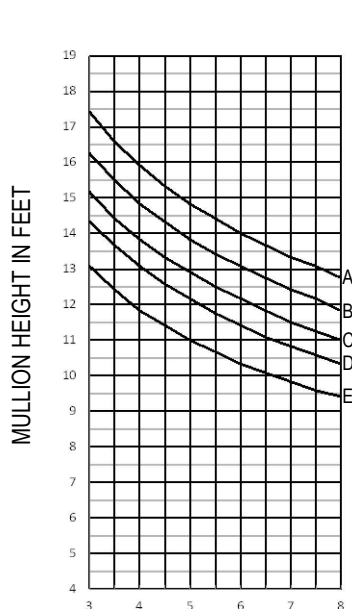


$$I = 8.786 \text{ IN}^4$$

$$S_1 = 2.627 \text{ IN}^3 \quad S_2 = 0.682 \text{ IN}^3$$

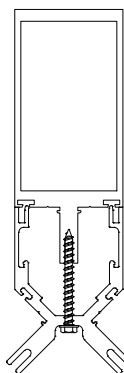


MULLION SPACING IN FEET

OPG6011 / OPG313 MOD.

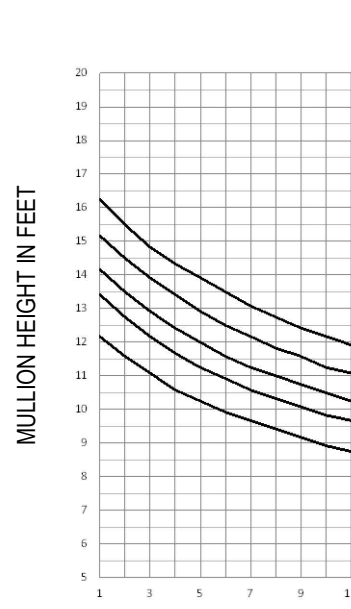

$$I = 7.080 \text{ IN}^4$$


$$S_1 = 2.117 \text{ IN}^3 \quad S_2 = 0.682 \text{ IN}^3$$

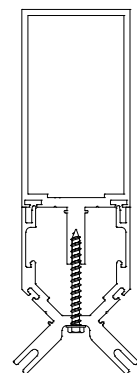

MULLION SPACING IN FEET

OPG6010 / OPG313 MOD.


Consult Your Local Arcadia Representative For Special Applications Not Covered By These Curves.



Windload Charts | T500 (OPG6000) Series


A = 16 P.S.F. (766 Pa) Description: 2 1/4" X 6" With 1/4" - 1 11/16" Glass
 B = 20 P.S.F. (958 Pa) Function: Curtain Wall
 C = 25 P.S.F. (1197 Pa) Detail: Design Criteria
 D = 30 P.S.F. (1436 Pa) Scale: N.T.S.
 E = 40 P.S.F. (1915 Pa)

SHEET 5 OF 5

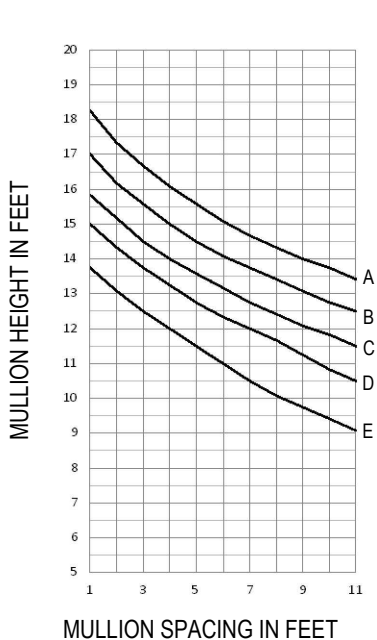


$$I = 10.229 \text{ IN}^4$$


$$S_i = 2.678 \text{ IN}^3$$

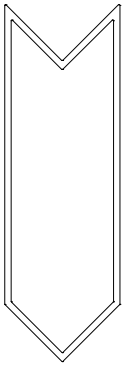

ICOC755

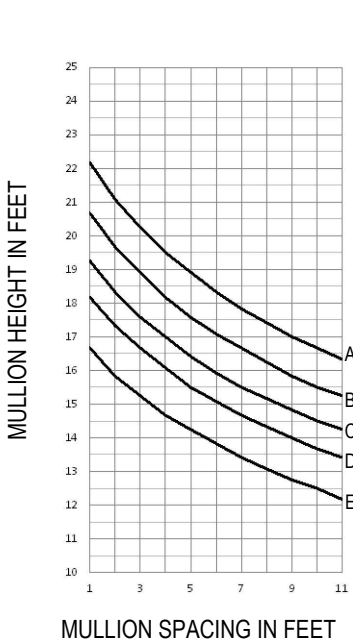


$$I = 19.097 \text{ IN}^4$$




ICOC755 WITH
STEEL REINFORCEMENT
1 7/8" X4 1/2" X 10 GA

- Mullions are assumed to be single span, simple beam elements, uniformly loaded and adequately braced to prevent lateral-torsional buckling. All other complex design conditions shall be reviewed by Arcadia or a design professional.
- Aluminum extrusions shall be 6063-T6 alloy. Allowable stresses to be derived per Aluminum Design Manual. Deflection limitation of mullions shall be in accordance with AAMA TIR-A11 of L/175 for spans up to 13'-6" and L/240 + 1/4" for all others where L is equal to the span of mullion.
- A design professional shall be consulted to confirm that no lite of glass deflects more than H/175 or 3/4", whichever is less, where H indicates the height of glass.
- For mullions containing steel reinforcement, the reinforcement is assumed to be installed for the full length of the mullion. A design professional shall be consulted for instances where steel reinforcement is installed for a partial length of the mullion span.
- Windload pressure determinations shall be per ASCE 7 and according to local governing codes. A professional engineer shall be consulted for the most current laws and local building codes.
- Selection of perimeter fasteners and attachment of glazing system to building structure are project specific and therefore shall be reviewed and determined by a design professional.
- Arcadia assumes no responsibility for selecting the appropriate systems for specific projects.

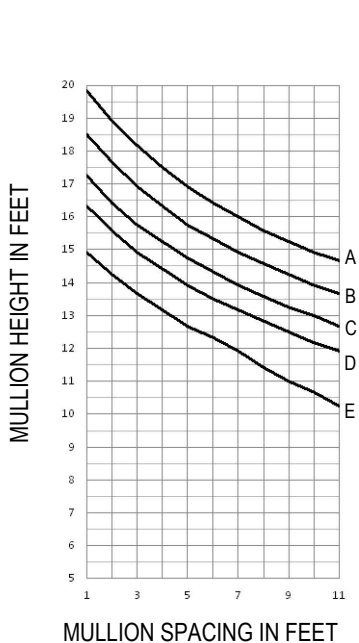


$$I = 13.431 \text{ IN}^4$$

$$S_i = 3.416 \text{ IN}^3$$

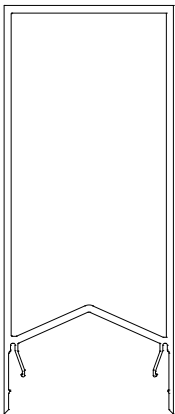


OPG1945

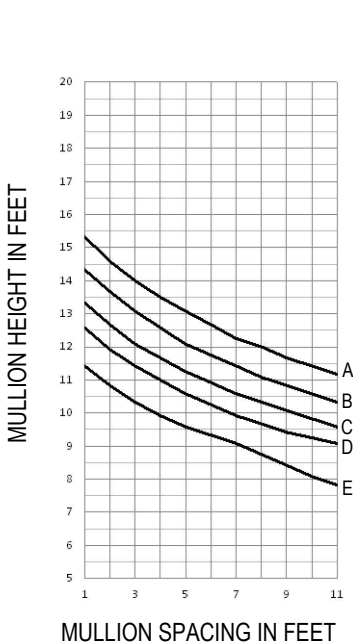





$$I = 5.845 \text{ IN}^4$$

$$S_i = 1.991 \text{ IN}^3$$

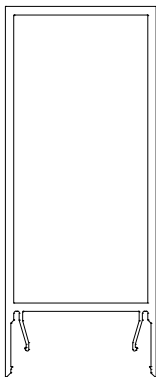

OPG1935




Consult Your Local Arcadia Representative For Special Applications Not Covered By These Curves.

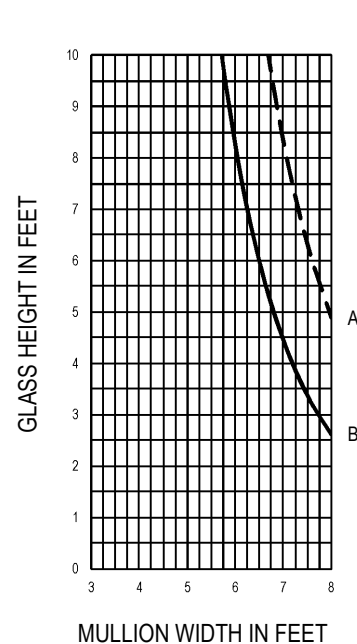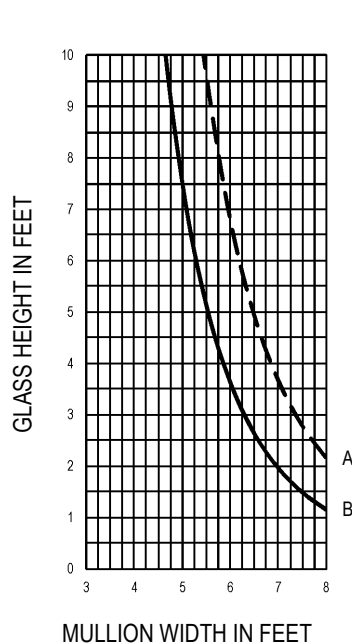


CURVE REPRESENTATION

A (----) = 1/8 PTS.

B (—) = 1/4 PTS.

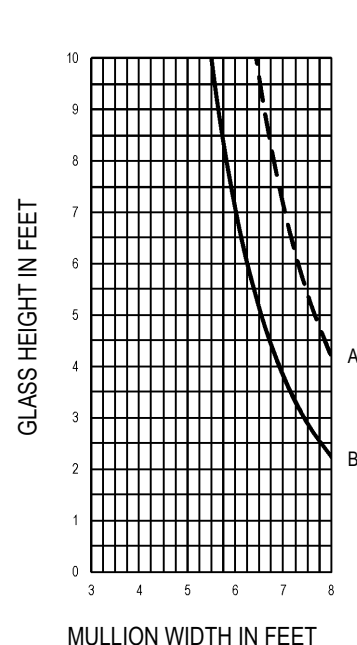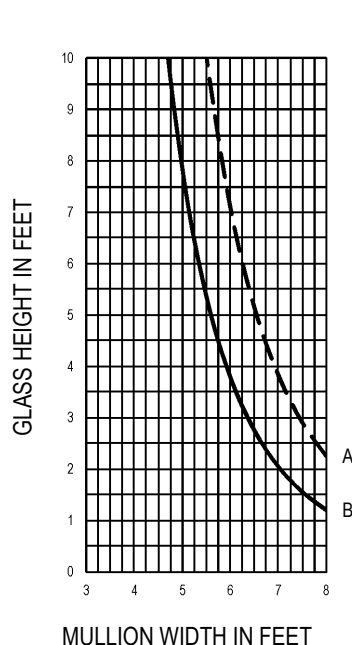



Deadload Charts | T500 (OPG6000) Series

Description: 2 1/4" X 6" With 1/4" - 1 11/16" Glass


Function: Curtain Wall

Detail: Design Criteria


Scale: N.T.S.

Deadload Charts for 1/2" Glass (6.50 PSF)


SHEET 2 OF 8

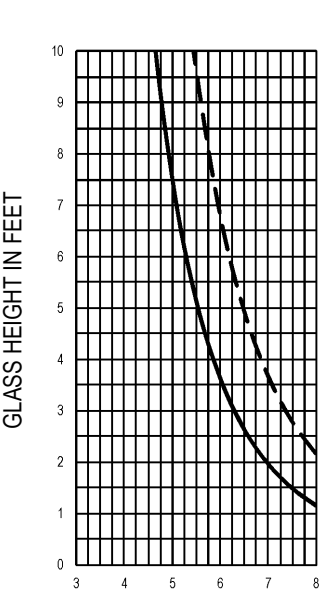


$I = 0.594 \text{ IN}^4$
 $S = 0.446 \text{ IN}^3$



OPG6027 - 1/2" GLASS

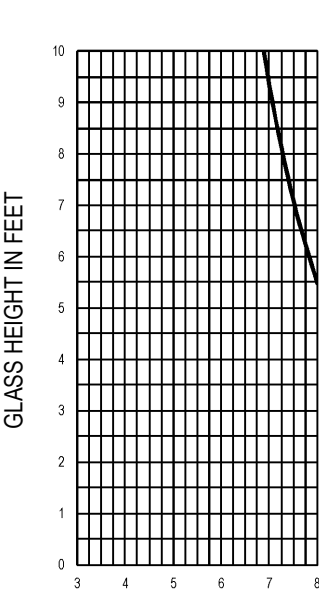

$I = 2.858 \text{ IN}^4$
 $S = 1.189 \text{ IN}^3$







OPG6400 - 1/2" GLASS

CURVE REPRESENTATION

A (----) = 1/8 PTS.




B (—) = 1/4 PTS.


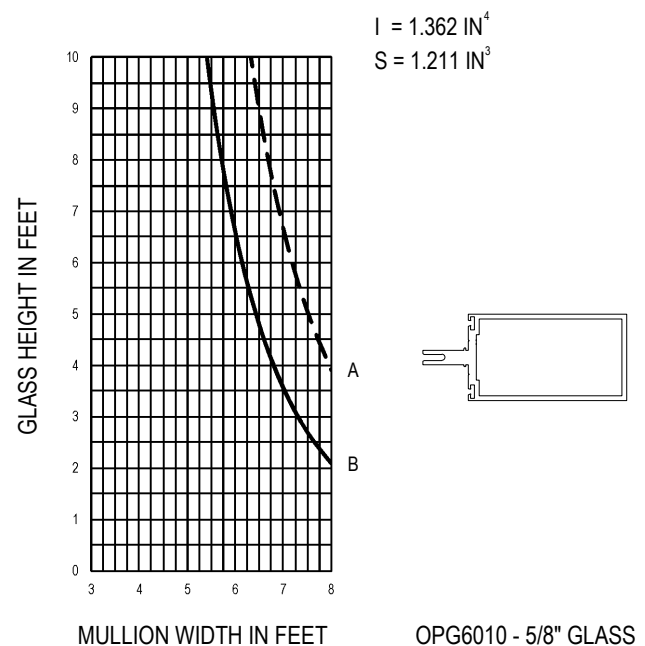

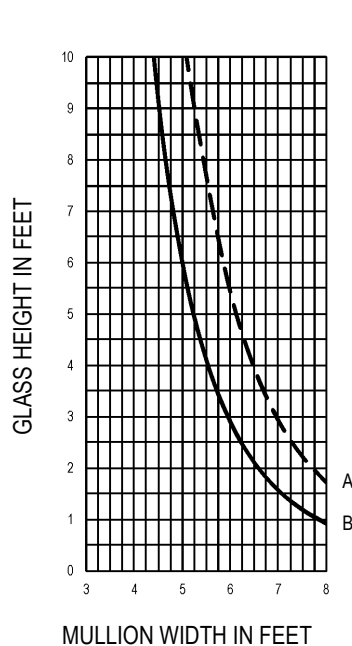


CURVE REPRESENTATION

A (----) = 1/8 PTS.

B (—) = 1/4 PTS.


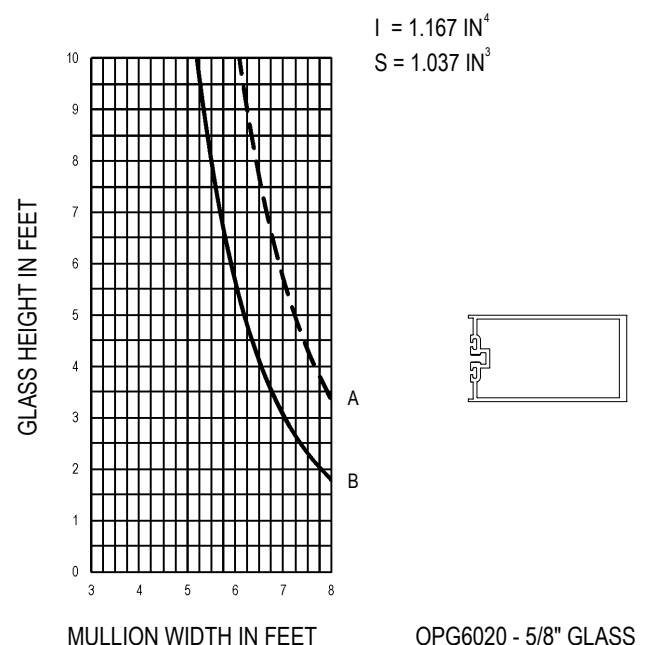

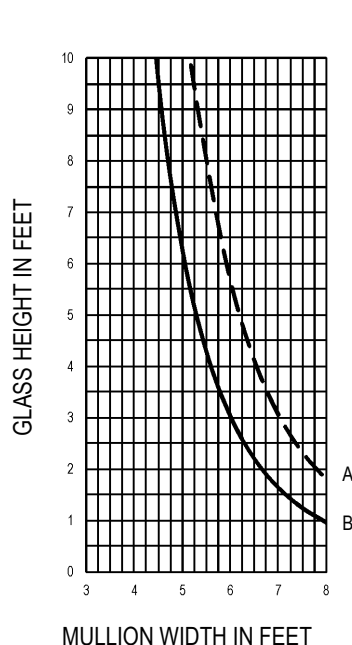


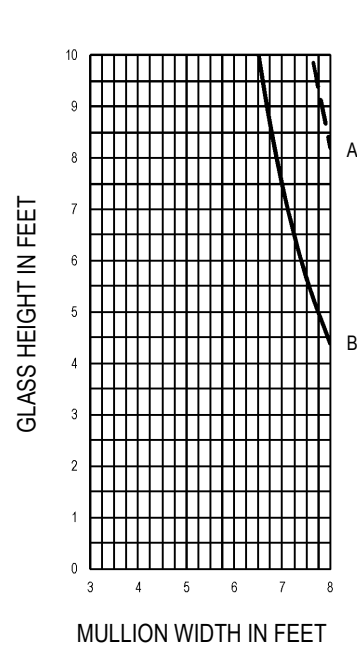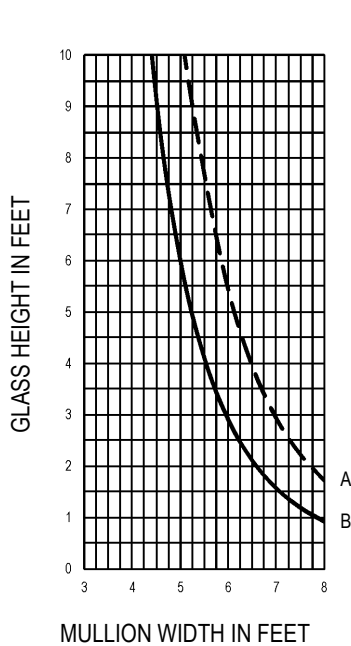

CURVE REPRESENTATION

A (----) = 1/8 PTS.




B (—) = 1/4 PTS.

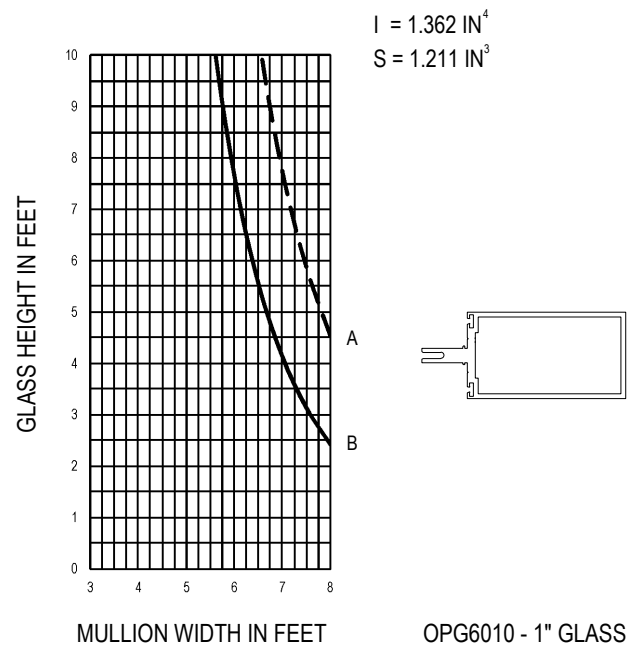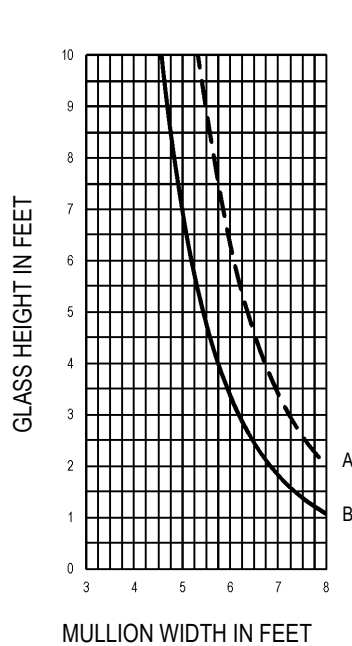

CURVE REPRESENTATION

A (---) = 1/8 PTS.


B (—) = 1/4 PTS.

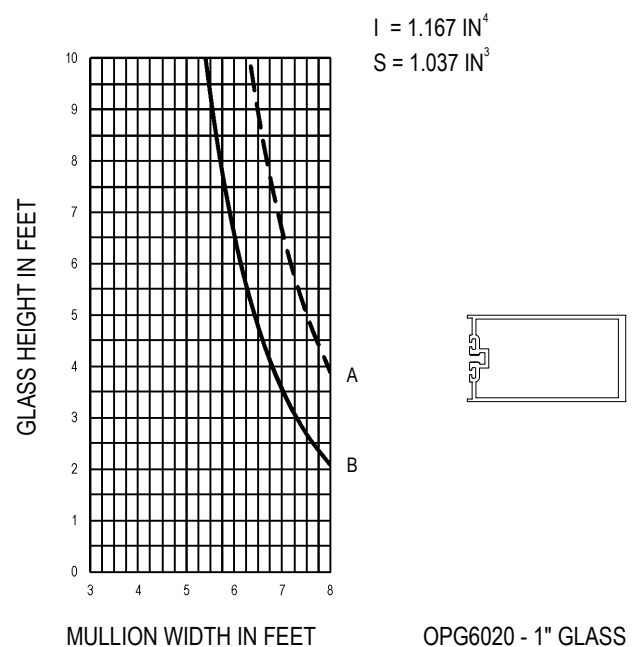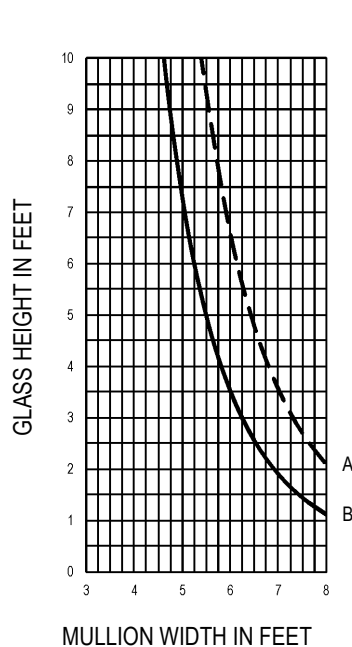

GLASS HEIGHT IN FEET

$$I = 0.594 \text{ IN}^4$$

$$S = 0.446 \text{ IN}^3$$



A
B



MULLION WIDTH IN FEET

OPG6027 - 1" GLASS

GLASS HEIGHT IN FEET

$$I = 2.858 \text{ IN}^4$$

$$S = 1.189 \text{ IN}^3$$

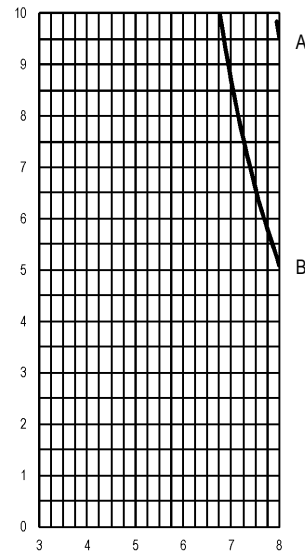

MULLION WIDTH IN FEET

OPG6400 - 1" GLASS

CURVE REPRESENTATION



A (----) = 1/8 PTS.

B (—) = 1/4 PTS.

GLASS HEIGHT IN FEET

$$I = 0.466 \text{ IN}^4$$

$$S = 0.330 \text{ IN}^3$$

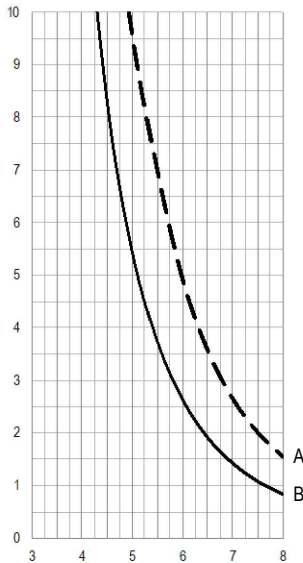



MULLION WIDTH IN FEET

OPG6052 - 1" GLASS

GLASS HEIGHT IN FEET





$$I = 0.490 \text{ IN}^4$$

$$S = 0.364 \text{ IN}^3$$

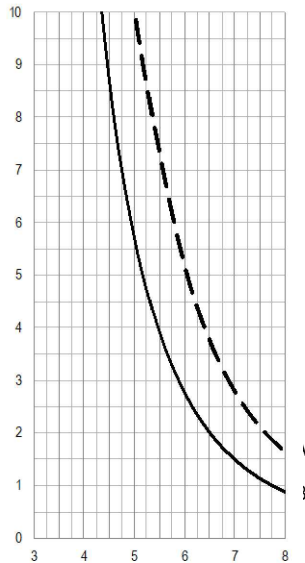

MULLION WIDTH IN FEET




OPG6053 - 1" GLASS


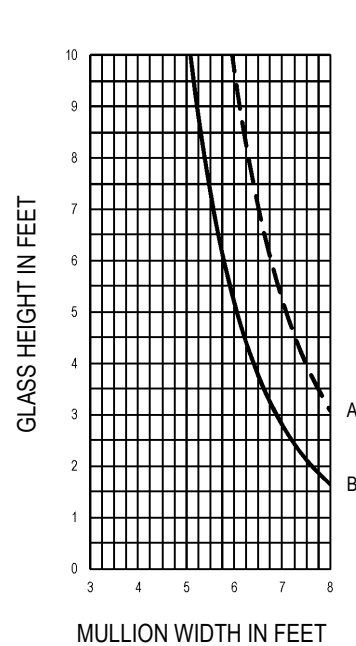

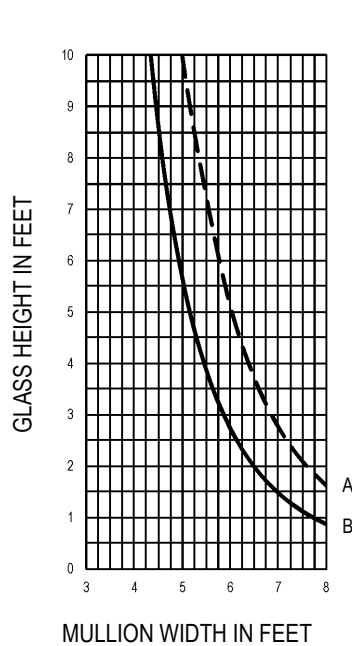


CURVE REPRESENTATION

A (----) = 1/8 PTS.

B (—) = 1/4 PTS.

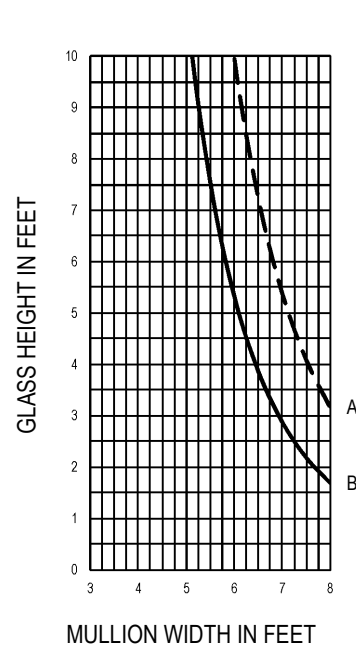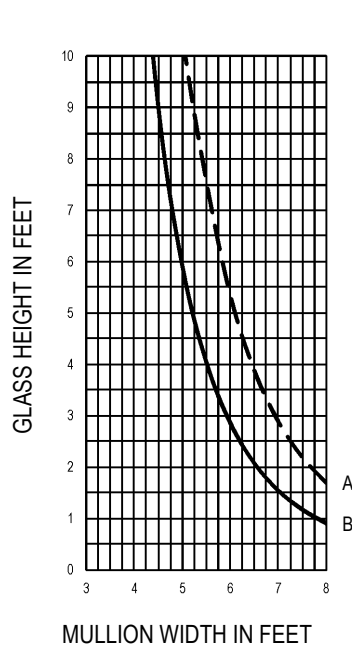

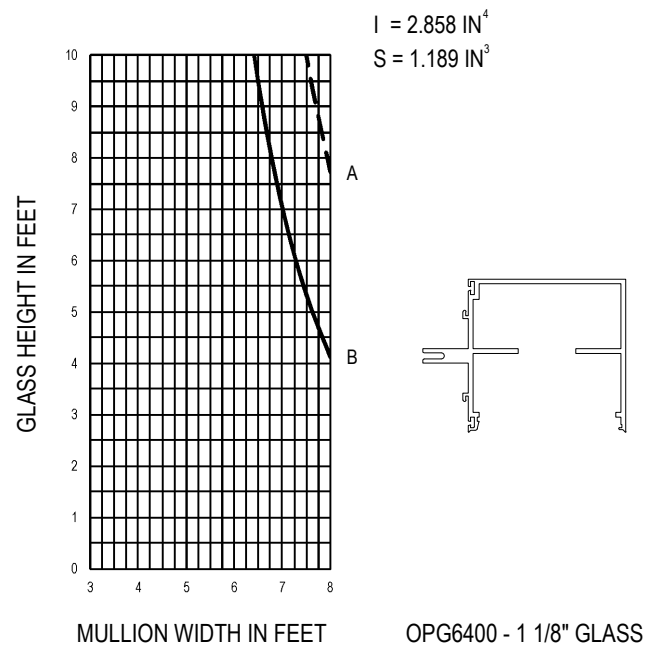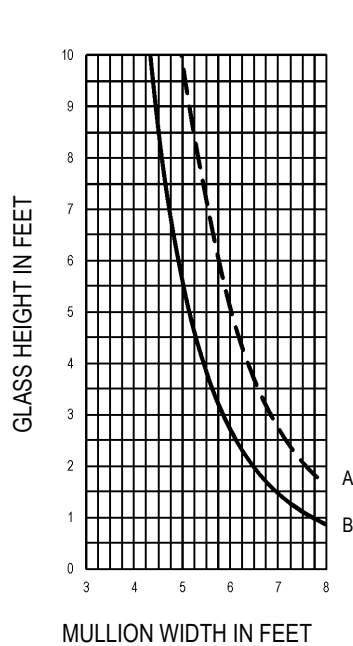

CURVE REPRESENTATION

A (----) = 1/8 PTS.

B (—) = 1/4 PTS.

